


DIMENSIONAL DATA

ATTENUATOR FOR UNIT SIZE	W
19	30 [762]
22	34 [864]


TOP VIEW

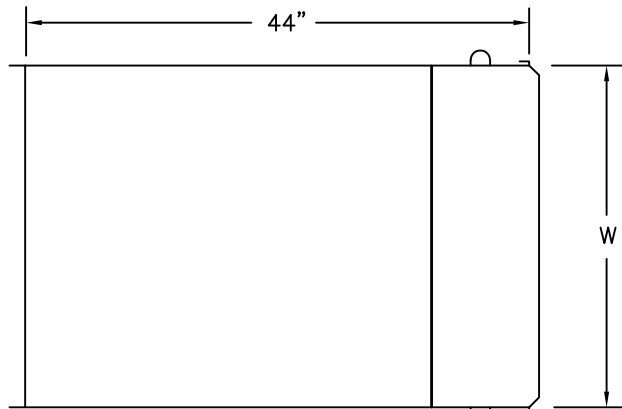

SUPPLY & RETURN WATER CONNECTION  
RIGHT HAND MOUNT (AS SHOWN) - STANDARD  
(SEE NOTE 3)

NOTE: SA-WC UNIT SHIPS SEPARATE FROM TERMINAL & REQUIRES FIELD CONNECTION (BY OTHERS)

FIELD CONNECTION (BY OTHERS-SEE NOTE 4)  
SIDE VIEW

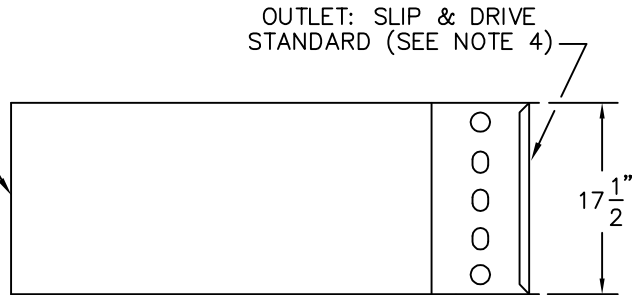

OUTLET: SLIP & DRIVE STANDARD (SEE NOTE 4)

HOT WATER COIL (SEE NOTE 3)

CONSTRUCTION NOTES:

1. MATERIAL: Galvanized steel; Casing -22 gauge.
2. INSULATION: 1/2" thick fiberglass complying with NFPA 90-A and UL 181.
3. HOT WATER COIL: Copper tubing with aluminum fins, 10 fins per inch. Supply and Return water connections: 1 Row coil: 1/2" O.D., 2 Row coil: 5/8" O.D., 3 & 4 Row coil: 7/8" O.D.. Coil to be externally insulated by others if required.
4. INSTALLATION: A) If internal insulation is utilized in the downstream ductwork, the insulation must be secured in such a manner that no raw insulation edges are exposed to the airstream.  
B) Hot water coil should be externally insulated by others (in the field) if required.  
C) Field connection of attenuator unit with sheet metal screws on each side and sealer on all four sides.

NOTE: All drawings subject to change without prior notice.

TITLE: MODEL SDR-SA-WC SINGLE DUCT  
TERMINAL UNIT - SZ 19 & 22  
SOUND ATTENUATOR W/WATER COIL  
FOR CONNECTION TO MODEL SDR



DRN BY: CV	DATE: 12/14/92	SCALE: N/A	DRAWING NO.  15911
CKD BY: Chris H	DATE: 06/23/06	REV: 02	