

NOTES:

1. COLD DUCT DAMPER FAILS NORMALLY CLOSED.
HOT DUCT DAMPER FAILS NORMALLY CLOSED.
2. MAIN AIR SUPPLY CONSUMPTION IS 0.033 SCFM.
3. PART NUMBER DEPENDENT ON UNIT SIZE.

ITEM	PART NO	DESCRIPTION
1	10065001	KMC CONTROLLER CSC-3011
2	10058501	KMC DAMPER ACTUATOR MCP-8031
3	NOTE 3	FLO-CROSS SENSOR


JOB NAME: _____
 LOCATION: _____
 ARCHITECT: _____
 ENGINEER: _____
 CONTRACTOR: _____

SUBMITTED BY: _____

REV LEVEL: A DATE: 9/01 DWG NO: 1414

DDV DUAL DUCT VAV
 PNEUMATIC CONTROLS - Reverse Acting
 N.C. Cold, N.C. Hot
 Reduced Mixing

CONTROL DIAGRAM

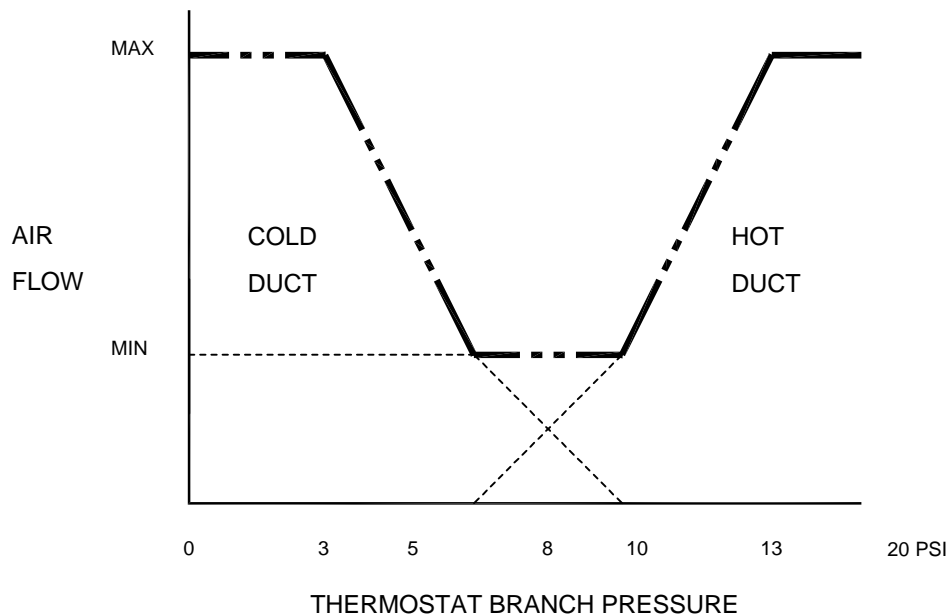

SEQUENCE OF OPERATION

- 1.) Hot duct air flow is at maximum and cold duct air flow is at zero when the thermostat branch pressure is at 13 PSIG or greater. On a rise in room temperature the thermostat branch pressure will increase and hot duct air flow will decrease. When hot duct air flow decreases from minimum to zero, the cold air duct will open to maintain the minimum air flow. As branch pressure continues to decrease to 3 PSIG or less the cold duct air flow will increase to maximum. The reverse will occur with a drop in room temperature.
- 2.) The hot duct damper fails closed and the cold damper fails closed with loss of pneumatic air.