
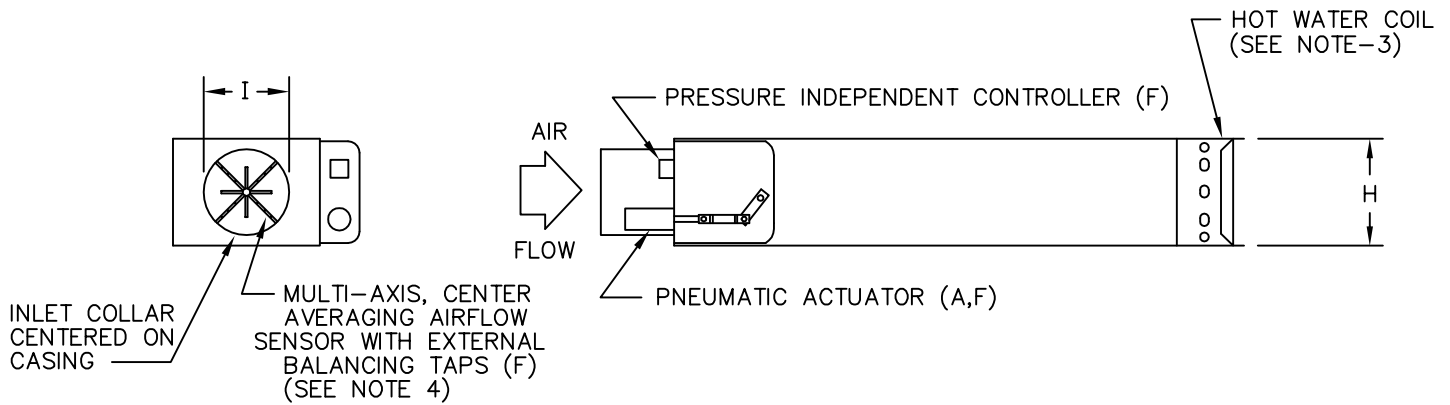


UNIT SIZE	W	H	A	I
4	10" [254]	10" [254]	10-1/2" [267]	3-7/8" [98]
5	10" [254]	10" [254]	10-1/2" [267]	4-7/8" [124]
6	10" [254]	10" [254]	6-1/2" [165]	5-7/8" [149]
8	12" [305]	10" [254]	6-1/2" [165]	7-7/8" [200]
10	14" [356]	12-1/2" [318]	6-1/2" [165]	9-7/8" [251]
12	16" [406]	15" [381]	6-1/2" [165]	11-7/8" [302]
14	20" [508]	17-1/2" [445]	6-1/2" [165]	13-7/8" [352]
16	24" [610]	17-1/2" [445]	6-1/2" [165]	15-7/8" [403]

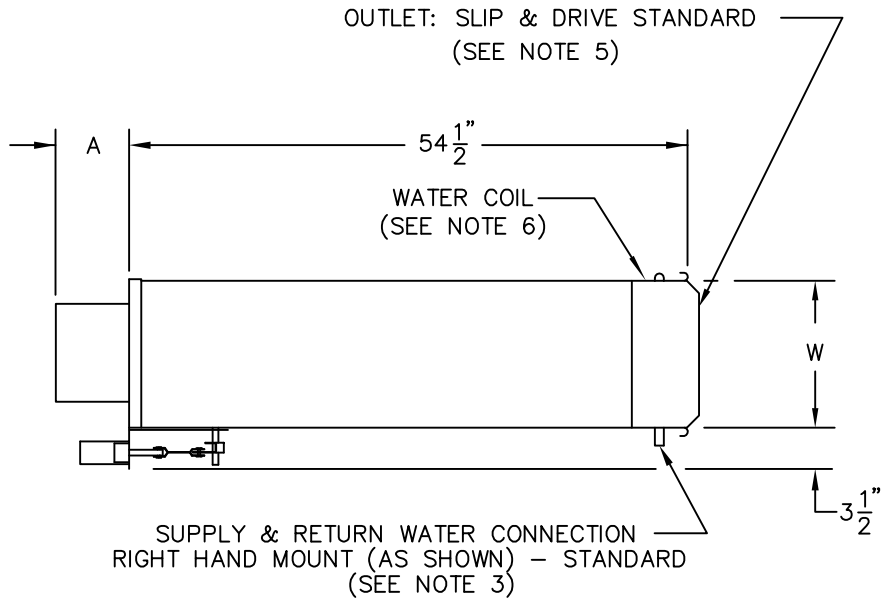

#### CONSTRUCTION NOTES:

- MATERIAL: Galvanized steel; Casing -22 gauge; Air valve casing -22 gauge.
- INSULATION: 1/2" thick fiberglass complying with NFPA 90-A and UL 181.
- HOT WATER COIL: Copper tubing with aluminum fins, 10 fins per inch. Supply and Return water connections: 1 Row coil: 1/2" O.D., 2 Row coil: 5/8" O.D., 3 & 4 Row coil: 7/8" O.D.. Coil to be externally insulated by others if required.
- AIRFLOW SENSOR: Sizes 4 & 5 utilize single-axis linear averaging type.
- INSTALLATION: A) If internal insulation is utilized in the downstream ductwork, the insulation must be secured in such a manner that no raw insulation edges are exposed to the airstream. B) Inlet collar & hot water coil should be externally insulated by others (in the field) if required.
- WATER COIL: SDR-SA-WC Units with 4-row coil are 55 1/2" in length.

NOTE: All drawings subject to change without prior notice.

(A) PRESSURE DEPENDENT - SERIES SD000

(F) PRESSURE INDEPENDENT - SERIES SD400

TITLE: MODEL SDR-SA-WC SINGLE DUCT  
TERMINAL UNIT  
PNEUMATIC CONTROLS



DRN BY: CV	DATE: 02/24/92	SCALE: N/A
CKD BY: Chris H	DATE: 04/17/13	REV: 03

DRAWING NO.  
15259