


**STANDARD FEATURES:**

1. 22 GAUGE GALVANIZED STEEL CASING CONSTRUCTION
2. 1/2" DUAL DENSITY LINING
3. ROUND INLET COMPATIBLE WITH NOMINAL RIGID AND FLEX DUCT CONNECTIONS
4. SLIP AND DRIVE DISCHARGE CONNECTION
5. PATENTED FLO-CROSS MULTIPOINT FLO SENSOR
6. DAMPER SHAFT WITH DELRIN BEARINGS AND POSITION INDICATOR
7. LOW LEAKAGE DAMPER WITH SEAL
8. HOT WATER HEAT (SD-7007)
9. INTEGRAL ATTENUATOR
10. RIGHT OR LEFT HAND CONFIGURATIONS AVAILABLE (RIGHT HAND SHOWN)

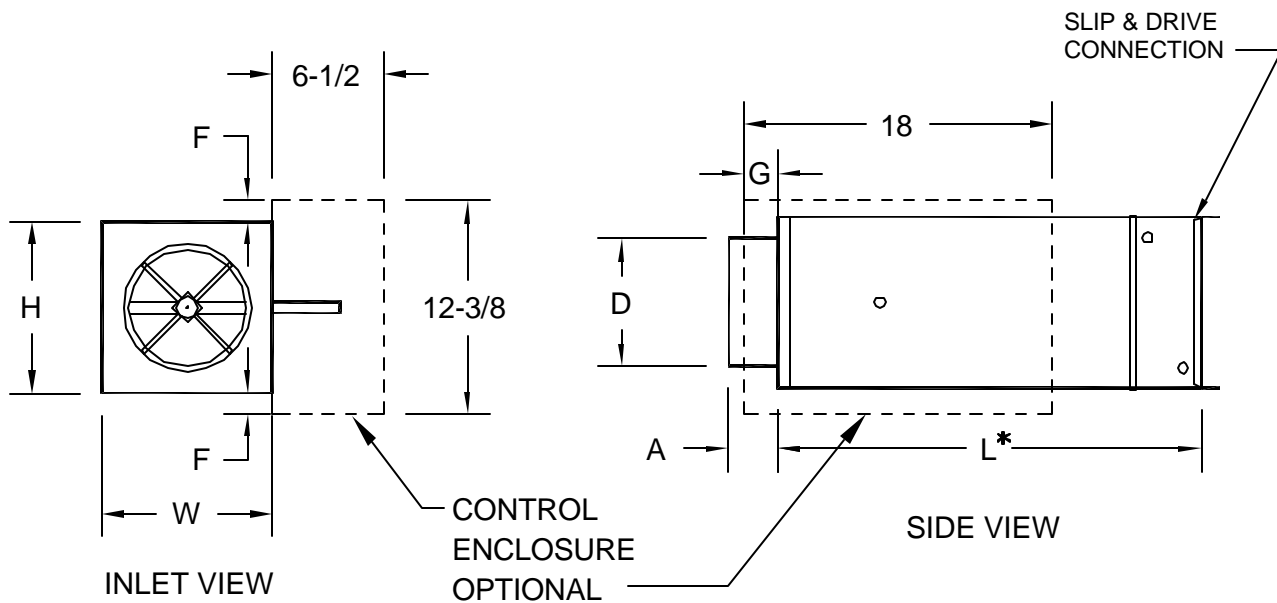

\* - ADD 2 1/4" TO THE "L" DIMENSION FOR A HANGAR ROW COIL.  
 NOTE: COIL CONNECTION SIZES ARE ALL 7/8", EXCEPT FOR THE SIZE 4,5,6,7,8 ONE ROW COILS WHICH ARE 1/2"

UNIT SIZE	CFM RANGE MIN TO MAX	L*	H	W	A	D	F	G	LINER OPTIONS:	CONSTRUCTION:	ACCESSORIES:
4	0/45 - 230	44 1/2	8	12	5 3/8	3 7/8	2 1/8	7 1/4	<input type="checkbox"/> 1/2" DUAL DENSITY	<input type="checkbox"/> 20 GAUGE	<input type="checkbox"/> CONTROL ENCLOSURE
5	0/70 - 360	44 1/2	8	12	5 3/8	4 7/8	2 1/8	7 1/4	<input type="checkbox"/> 1" DUAL DENSITY	<input type="checkbox"/> ACCESS DOOR	<input type="checkbox"/> DISC. SWITCH
6	0/100 - 520	44 1/2	8	12	3 3/8	5 7/8	2 1/8	7 1/4	<input type="checkbox"/> ENVIROSEAL	<input type="checkbox"/> CAM LATCHES	<input type="checkbox"/> DUSTTIGHT SEAL
7	0/140 - 710	44 1/2	10	12	3 3/8	6 7/8	1 1/8	7 1/4	<input type="checkbox"/> INSULGUARD	CAM LATCHES REQUIRE AN ACCESS DOOR	<input type="checkbox"/> HANGER BKT
8	0/185 - 925	44 1/2	10	12	3 3/8	7 7/8	1 1/8	7 1/4	<input type="checkbox"/> NO LINER		<input type="checkbox"/> TRANSFORMER
10	0/290 - 1450	44 1/2	12 1/2	14	3 3/8	9 7/8	-	5 1/4	<input type="checkbox"/> GAL. SHEET METAL LINER		<input type="checkbox"/> 120V / 24V
12	0/420 - 2100	44 1/2	15	16	3 3/8	11 7/8	-	5 1/4	SEE SUBMITTAL SD-7005 FOR LINER PROPERTIES		<input type="checkbox"/> 208V / 24V
14	0/580 - 2900	47	17 1/2	20	3 3/8	13 7/8	-	3 1/4			<input type="checkbox"/> 240V / 24V
16	0/740 - 3700	47	18	24	3 3/8	15 7/8	-	3 1/4			<input type="checkbox"/> 277V / 24V <input type="checkbox"/> 480V / 24V

JOB NAME: _____	SUBMITTED BY: _____	<b>SDV - SINGLE DUCT TERMINAL UNIT</b>  WITH HOT WATER COILS AND INTEGRAL ATTENUATOR
LOCATION: _____	DATE: <u>  </u> / <u>  </u> / <u>  </u>	
ARCHITECT: _____	DRAWING NUMBER: SD-7003	
ENGINEER: _____		
CONTRACTOR: _____		