


- NOTES:
- 1 STAGE OF HEAT, MINIMUM 25 VA
  - 2 STAGE OF HEAT, MINIMUM 35 VA
  - 3 STAGE OF HEAT, MINIMUM 45 VA
  - MAXIMUM 10 VA.
  - SUPPLIED, MOUNTED, WIRED AND/OR PIPED BY MFG.
  - LOW TUBING IS BLUE, HIGH IS RED
  - EARTH GROUNDING OF CHASSIS MUST BE PROVIDED BY OTHERS IN THE FIELD. (IF REQUIRED).
  - COMPONENT LOCATED IN HEATER CABINET REFER TO HEATER WIRING DIAGRAM.
  - CONNECT CONTROLLER TO THERMOSTAT BETWEEN SA BUS. CONNECTION MAY ALSO BE MADE USING RJ45 JACK.
  - MAY BE DIRECT WIRE DEPENDING ON MOTOR TYPE.
  - SEE ORDER ACKNOWLEDGEMENT FOR OPTIONAL ITEM REQUIREMENTS.

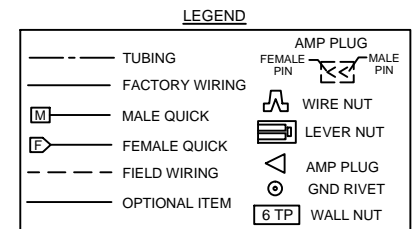

UNCONTROLLED DOCUMENT WHEN PRINTED

THIS DRAWING MAY NOT REFLECT THE MOST CURRENT REVISION. PLEASE CHECK TO MAKE SURE DRAWING IS CURRENT.

THIS DRAWING CONTAINS PROPRIETARY DATA. UNAUTHORIZED DISCLOSURE REPRODUCTION, OR USE IS STRICTLY PROHIBITED WITHOUT WRITTEN PERMISSION.

TITLE:	MATERIAL:
WD, FAN CONTROLS, FPC-ZEC103 SUBMITTAL	

REVISION DESCRIPTION	ZONE
REVISED FOR ZEC DESIGN CHANGES (PRESSURE SW,SAT & DAT) AS PER SEQUENCE OF OPERATION	

ECR NO.	BY	DATE	CK BY	DATE	DO NOT SCALE DRAWING DIMENSIONS ARE IN INCHES UNLESS OTHERWISE NOTED	SCALE	PART NO.	SHEET	DRAWING NO	REV
3889	SP	03/29/19	AR / JAC	03/29/19		NTS	87-10984 -00		87-10984	02