



FIG. 3

**1-2 ROW HOT WATER
MOUNTED IN DISCHARGE SECTION**

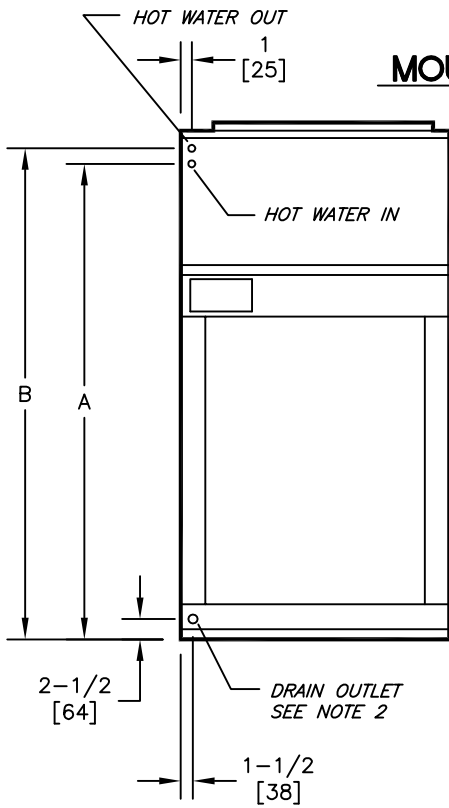

LEFT HAND UNIT

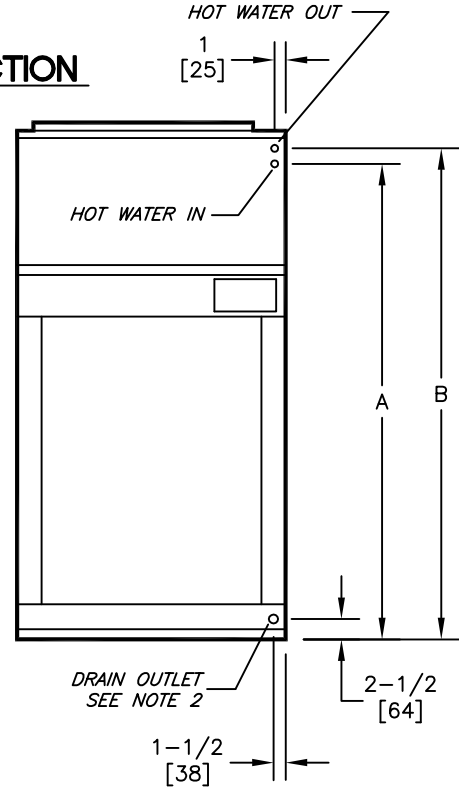

RIGHT HAND UNIT

UNIT SIZE	1 ROW HOT WATER COIL			2 ROW HOT WATER COIL			
	CONN SIZE	A	B	CONN SIZE	A	B	
08	5/8 [16]	55-1/4 [1403]	56-1/2 [1435]	5/8 [16]	55-1/4 [1403]	56-1/2 [1435]	
12		65-1/4 [1657]	66-1/2 [1689]		7/8 [22]	65 [1651]	66-1/2 [1689]
16						75 [1905]	76-1/2 [1943]
20		75-1/4 [1911]	76-1/2 [1943]	74-3/4 [1898]	76-1/2 [1943]		
25		75 [1905]		74-3/4 [1898]			
30		75 [1905]					

NOTES:

- All dimensions are Inches [millimeters]. All dimensions are $\pm 1/2"$ [13mm]. Metric values are soft conversion.
- Standard galvanized drain pan has 1-1/8" ODM copper connection. Optional stainless steel drain pan has 1" galvanized Sch. 40 threaded steel connection.
- Discharge section is required for heating coil on 4-pipe units with 6 row cooling and all units with standard steam heating.
- Heating-only units may not include a drain pan. See actual order documents.
- Heating coils in discharge section have connections on same side as cooling coil connections.
- Dimensions are based on unit cabinet only, and do not include filter rack or base rail.

TITLE: MDL VB/VR, SERIES C, CONNECTION LOCATIONS
BELT DRIVE BLOWER COIL UNIT
DISCHARGE SECTION 1 & 2 ROW HOT WATER



DRN BY: JGH	DATE: 3/20/15	SCALE: 1=22	DRAWING NO.
CKD BY: DB	DATE: 3/20/15	REV: 02	

THIS DRAWING CONTAINS PROPRIETARY DATA.
UNAUTHORIZED DISCLOSURE, REPRODUCTION, OR USE
IS STRICTLY PROHIBITED WITHOUT WRITTEN PERMISSION

DO NOT SCALE DRAWING
DIMENSIONS AND DATA ARE SUBJECT TO CHANGE WITHOUT NOTICE.
CONTACT FACTORY FOR CERTIFIED DRAWINGS.

BRC-003