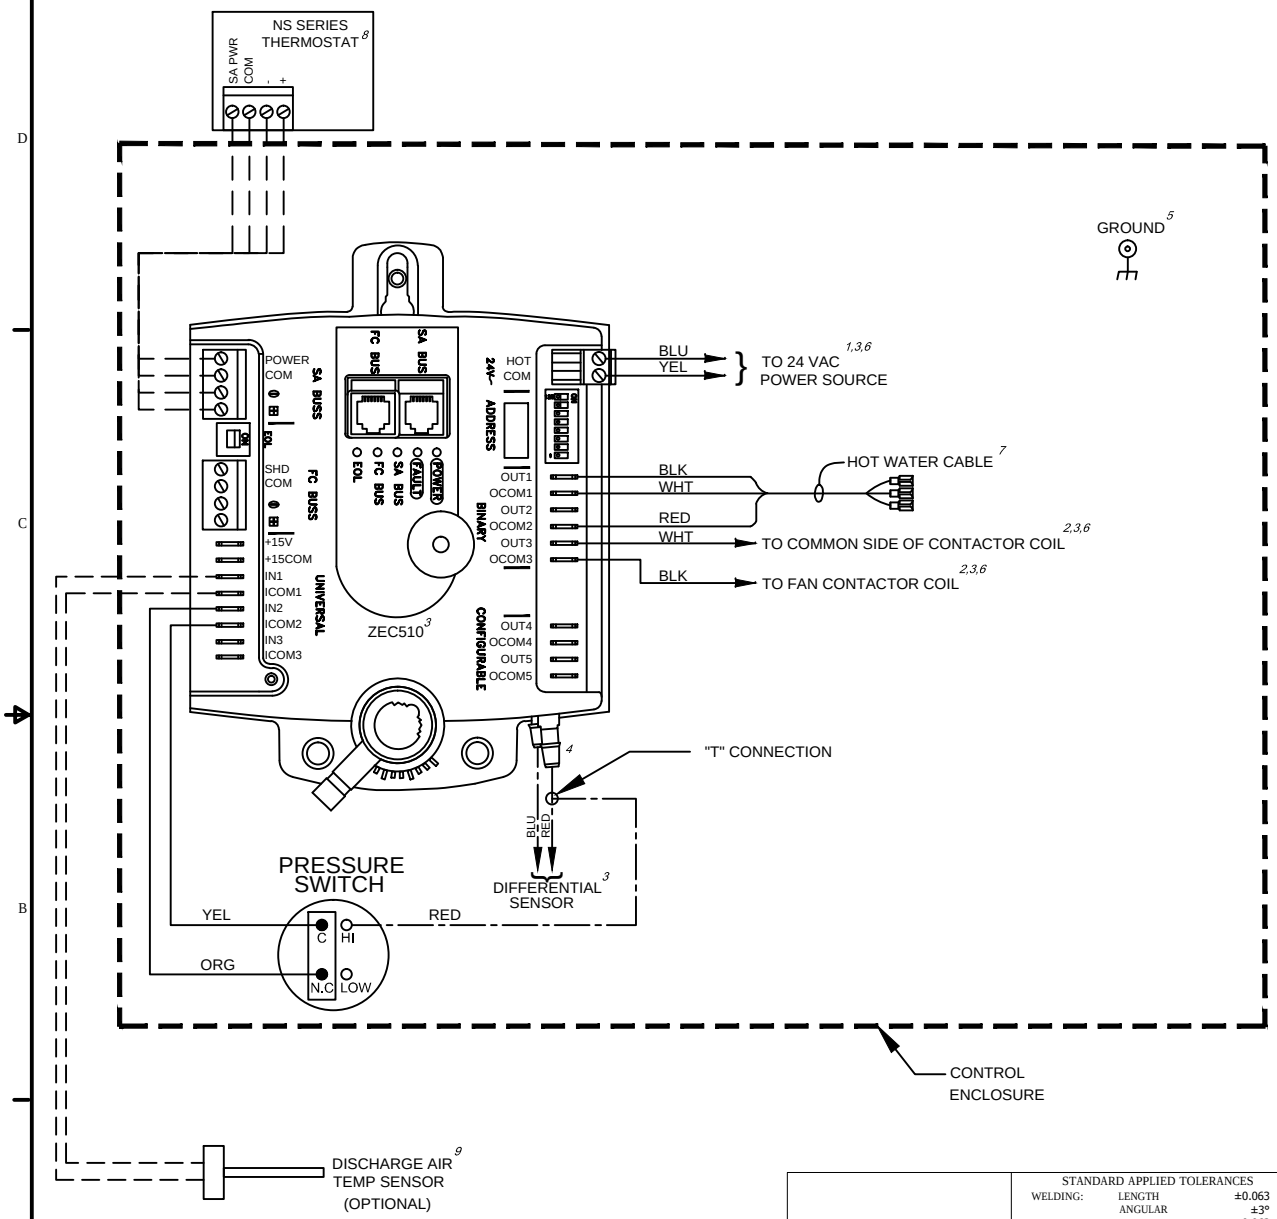

NOTES:

1. MINIMUM 25 VA
   NOTE:POWER CONSUMPTION REQUIREMENTS
   * WILL VARY DEPENDING UPON FIELD SUPPLIED/MOUNTED ACCESSORIES.
2. MAXIMUM 10 VA.
3. SUPPLIED, MOUNTED, WIRED AND/OR PIPED BY MFG.
4. LOW TUBING IS BLUE, HIGH IS RED
5. EARTH GROUNDING OF CHASSIS MUST BE PROVIDED BY OTHERS IN THE FIELD. (IF REQUIRED).
6. REFER TO MOTOR WIRING DIAGRAM FOR TRANSFORMER AND FAN RELAY WIRING (IF APPLICABLE).
7. 8' CABLE PROVIDED BY JCI FOR WIRING OF FIELD PROVIDED VALVE. CABLE ONLY PROVIDED ON UNITS WITH HOT WATER COILS.
8. CONNECT CONTROLLER TO THERMOSTAT BETWEEN SA BUS. CONNECTION MAY ALSO BE MADE USING RJ45 JACK.
9. SEE ORDER ACKNOWLEDGEMENT FOR OPTIONAL ITEM REQUIREMENTS.

LEGEND

- TUBING
- FACTORY WIRING
- M — MALE QUICK
- F — FEMALE QUICK
- FIELD WIRING
- OPTIONAL ITEM
- AMP PLUG (FEMALE PIN / MALE PIN)
- WIRE NUT
- LEVER NUT
- AMP PLUG
- GND RIVET
- 6 TP — WALL NUT

UNCONTROLLED DOCUMENT WHEN PRINTED

STANDARD APPLIED TOLERANCES		
WELDING:	LENGTH	±0.063
	ANGULAR	±3°
	SQUARE	±0.063
Cu TUBING:	CUT LENGTH	±0.063
	FORMED LENGTH	±0.125
	FORMED ANGLE	±5°
SHEET METAL:	HOLE DIA	±0.005
	CUT SIZE	±0.031
	CUT ANGLE	±1°
	CUT SQUARE	±0.016
	FORMED DIM	±0.031
	FORMED ANGLE	±3°
	FORMED SQUARE	±0.031

THIS DRAWING MAY NOT REFLECT THE MOST CURRENT REVISION. PLEASE CHECK TO MAKE SURE DRAWING IS CURRENT.

THIS DRAWING CONTAINS PROPRIETARY DATA. UNAUTHORIZED DISCLOSURE REPRODUCTION, OR USE IS STRICTLY PROHIBITED WITHOUT WRITTEN PERMISSION.

REVISION DESCRIPTION: REVISED FOR ZEC DESIGN CHANGES (PRESSURE SW,SAT & DAT) AS PER SEQUENCE OF OPERATION

ZONE:

TITLE: WD, FAN CONTROLS, FPC-ZEC202 SUBMITTAL

MATERIAL:

ECR NO.	BY	DATE	CK BY	DATE	SCALE	PART NO.	SHEET	DRAWING NO	REV
3889	SP	03/29/19	AR / JAC	03/29/19	NTS	87-10987 -00		87-10987	01

DO NOT SCALE DRAWING
DIMENSIONS ARE IN INCHES UNLESS OTHERWISE NOTED