

Features

Provides additional notification appliance circuit (NAC) capacity with flexible operation modes and power-limited design

Four, Class B NACs are standard and have the following features:

- Rated 2 A each for conventional reverse polarity 24 VDC notification appliances and providing multiple operation modes
- You can select the NAC to synchronize Autocall visible notification strobe flashes.
- Control support for TrueAlert non-addressable notification appliances operating with SmartSync two-wire control mode.

Input control options:

- IDNet addressable communications from a 4007ES, 4010, 4010ES, or 4100ES Fire Alarm Control Panel.

Note: 4100U requires revision 11 software or higher for compatibility. 4010 requires revision 2 software or higher for compatibility.

- Control from one or two conventional 24 VDC NACs with multiple output control options

IDNet communications control benefits:

- Status monitoring and individual NAC control using a single address for each 4009 IDNet NAC Extender
- IDNet Device Level earth fault location support

WALKTEST operation is available with either input choice

Internal 8 A power supply or battery charger:

- Charges internal batteries up to 12.7 Ah or up to 18 Ah batteries in external cabinet
- Provides status monitoring of battery, input power, and earth faults
- Rated 8 A for Special Application appliances; including 4901, 4903, 4904, and 4906 Series horns, strobes, horn/strobes, and speaker/strobes
- Rated 6 A for Regulated 24 DC appliance power

Optional 4009 IDNet NAC Extender modules:

- IDNet Communications Repeater provides Class B or Class A output
- IDNet Communications Fiber Optic Receiver/Repeater, available as Class B or Class X
- Four additional Class B NACs, rated 1.5 A for Special Application appliances; 1 A for Regulated 24 DC appliance power
- Class A, Two Circuit Adapter Module

UL Listed to Standard 864

External Accessories

IDNet communication fiber optic transmitters:

- For applications requiring the data integrity available with fiber optic communications
- Available as Class B or Class X
- Mountable in standard six-gang electrical box

External battery cabinet for 18 Ah batteries

Introduction

ADA compliance. Complying with the notification requirements of the ADA (Americans with Disabilities Act) may require more notification appliance power than is available within the fire alarm control panel. When additional power is required, a 4009 IDNet NAC Extender can provide up to 8 A of NAC power with up to eight, supervised reverse polarity NACs.

Location flexibility. You can mount the 4009 IDNet NAC Extender close to a compatible dedicated host panel or remotely for convenient power distribution. Multiple operation modes and multiple connection options further increase location flexibility.

Additional information. For additional operation detail and application information, refer to *Installation Instructions 574-181* and *field wiring diagram 842-068*.

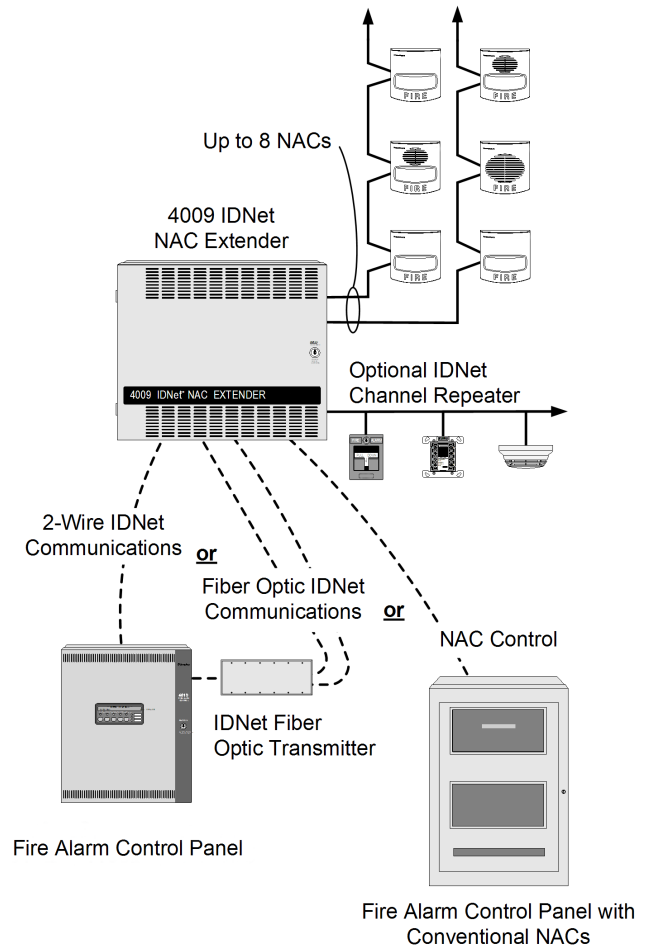


Figure 1: 4009 IDNet NAC Extender connection reference drawing

* Additional listings may be applicable; contact your local product supplier for the latest status.

Application and operation information

IDNet addressable communications compatible. You can control up to ten, 4009 IDNet NAC Extenders for each 4007ES, 4010ES or 4100ES IDNet communications channel. You can control each output NAC individually for general alarm or selective area notification requiring only one point address for each Extender. You can also control Individual Extender NACs manually from the host panel. IDNet controlled extenders inform the host panel of troubles using IDNet communications.

Optional IDNet repeaters. IDNet communications can be repeated with the optional IDNet Repeater Module or with the optional Fiber Optic Receiver Module. Up to 100 of the IDNet channel points can be repeated once. Refer to [Typical IDNet connection example](#) and [4009 IDNet NAC Extender specifications](#) for details. Repeated IDNet communications also support the device level earth fault location utility of the host panel.

Hardware control applications. You can control the 4009 IDNet NAC Extender directly from the NAC for applications where an existing, or new conventional NAC needs additional power. You can connect one or two NACs, from the same, or different host fire alarm control panels, to control the 4009 IDNet NAC Extender output NACs. Multiple control selections provide flexible operation. Refer to [Hardware Control Connection Information](#) for more detail. Alarms from the host panel activate four, or optionally eight, 4009 IDNet NAC Extender NACs, to extend the alarm.

The 4009 IDNet Extender monitors itself and each of its output NACs for trouble conditions, including earth faults. Extenders wired to conventional NACs indicate a trouble by opening the path to the NAC's end-of-line resistor, but retaining the ability to respond to alarms. LEDs located on the 4009 IDNet NAC Extender main circuit board also annunciate individual troubles. Refer to [Service diagnostic features](#) for more diagnostic information.

Product selection

Table 1: Standard models

Model	Description	
A009-9201, see note	120 VAC input	4009 IDNet NAC Extender with 4, Class B NACs and 8 A power supply
A009-9301	240 VAC input	
A4009-9202CA (ULC listed model)	120 VAC input	
Note: A009-9201 has been seismic tested and is certified to IBC and CBC standards as well as to ASCE 7 categories A through F, requires battery brackets as detailed on data sheet AC2081-0019		

Table 2: Optional modules (for on-site installation)

Model	Description	Comments
A009-9807	Additional four point NAC module, rated 1.5 A Special Application appliances; 1 A for Regulated 24 DC appliance power, Class B	One maximum
A009-9808	Dual Class A adapter (for two NAC outputs)	Select as required (four maximum)
A009-9809	IDNet Repeater, output is Class A or Class B	Select either an IDNet Repeater or a Fiber Optic Receiver as required; one transmitter can connect to one receiver
A009-9810	Fiber Optic Receiver	Class B
A009-9811	Fiber Optic Receiver	Class A (IDNet), Class X (fiber)
A009-9805	Red Appliqué for door	

Table 3: Battery selection (select battery size using system requirements)

Model	Description	Comments
2081-9272	6.2 Ah Battery, 12 VDC	Two batteries are required, 24 VDC operation
2081-9274	10 Ah Battery, 12 VDC	
2081-9275	18 Ah Battery, 12 VDC	

Table 4: External accessories (select using system requirements)

Model	Description	Comments
A4090-9105	IDNet Fiber Optic Transmitter	Class B operation
A4090-9107		Class X operation
		Mounts in six-gang electrical box, refer to A4090-9105/9107 IDNet fiber optic transmitter mounting information for mounting details Note: Class B Fiber Transmitter Rev C or higher, IS NOT COMPATIBLE with Class B Fiber Receiver before Rev J.
A009-9801	External battery cabinet for up to 18 Ah batteries, beige	16 1/4 in. W x 13 1/2 in. H x 5 3/4 in. D (413 mm x 343 mm x 146 mm)
4081 series	End-of-Line resistor harnesses; see data sheet A4081-0003 for details	

Typical IDNet connection example

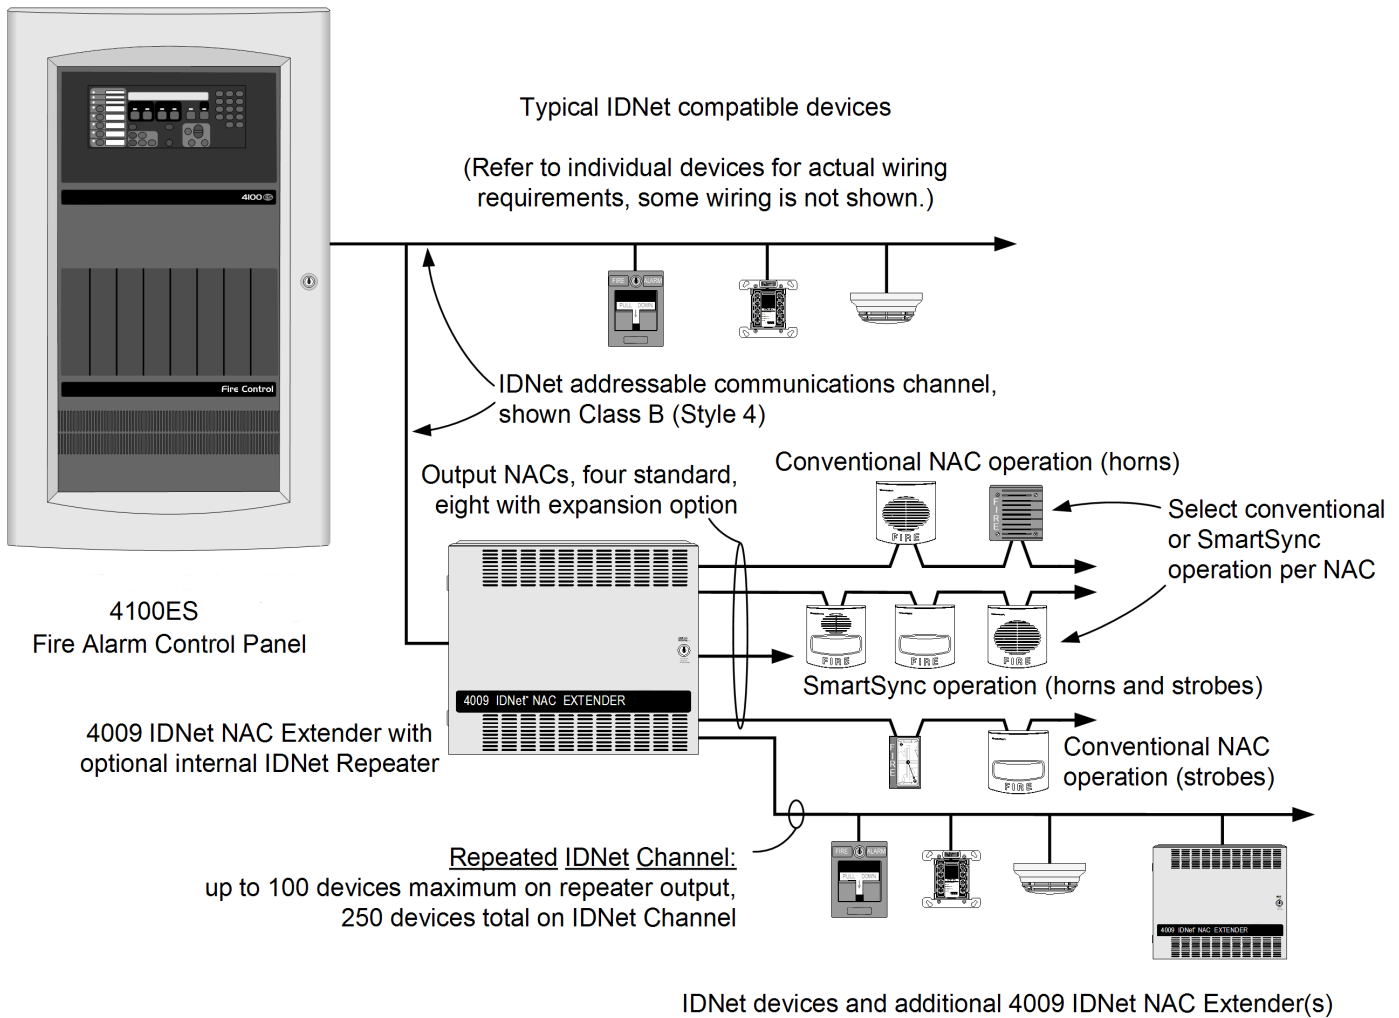


Figure 2: Typical IDNet connection example

Note: You can connect up to 10 4009 IDNet NAC Extenders using 4007ES, 4010ES, or 4100ES IDNet channel. IDNet communications can be repeated only once and pass through only one series connected repeater or one fiber optic receiver.

Typical fiber optic system connections

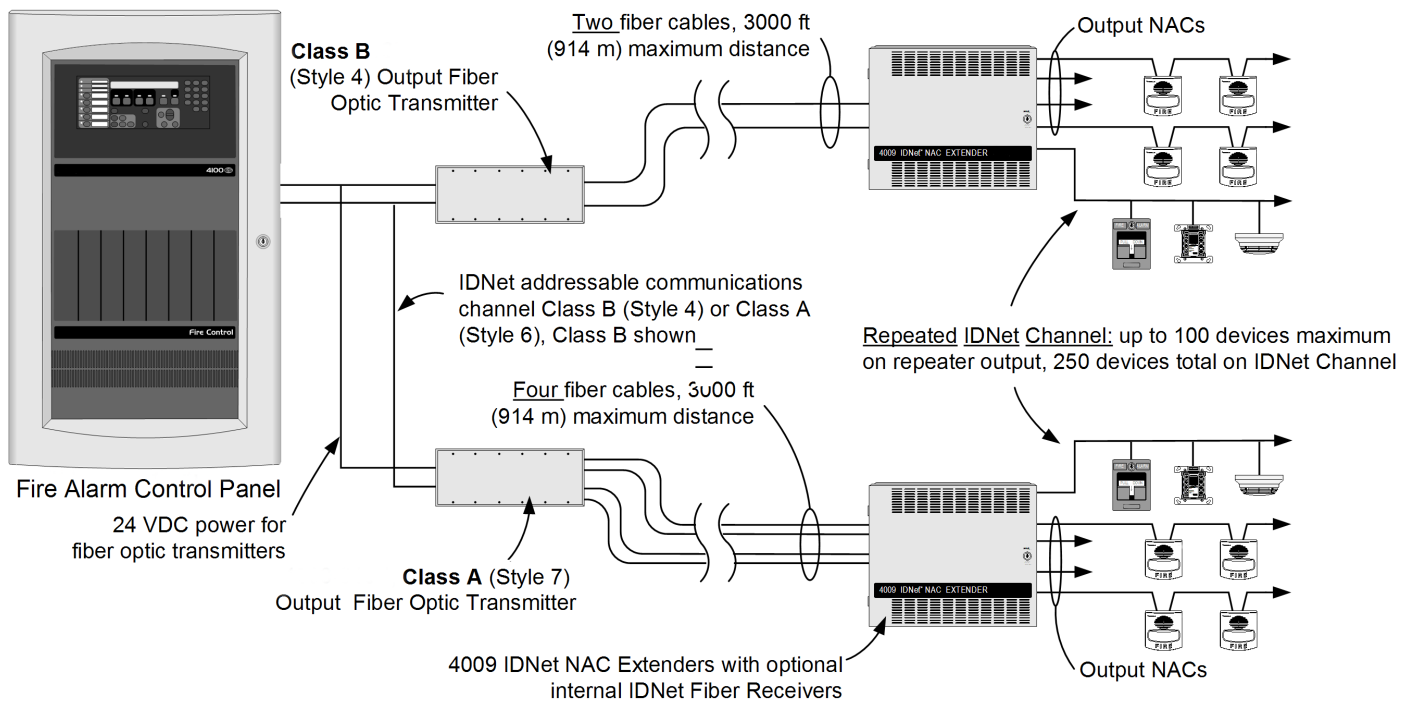


Figure 3: Typical fiber optic system connections

Note: You can connect up to 10 4009 IDNet NAC Extenders for each 4007ES, 4100ES, or 4010ES. IDNet communications can be repeated only once and pass through only one series connected repeater or one fiber optic receiver. Fiber optic transmitters connect to only one receiver in a 4009 IDNet NAC Extender.

Hardwire Control Connection Information

NAC Input Selections. The 4009 IDNet NAC Extender can be selected to:

- Track input NAC operation or to provide a locally generated code, selectable using NAC input.
- If selected for local coding, NAC outputs can be either Temporal Coded or 60 Beats/min March Time Coded. One code selection per extender. Input NACs must be on continuous with Alarm.
- Additionally, NAC outputs can be selected to provide the Autocall strobe synchronization signal. This signal synchronizes the flashes of synchronized strobes but is ignored by free-run strobes and audible devices. Strobes are for operation by noncoded NACs.

You can select NAC input to NAC output control for standard and optional NACs. Refer to the following table :

Table 5: Conventional NAC Output Operation Options

Input	A	B	C
NAC 1	NACs 1 and 2, 5 and 6	NACs 1 - 4	NACs 1 - 8
NAC 2	NACs 3 and 4, 7 and 8	NACs 5 - 8	-

Table 6: SmartSync NAC Output Operation

Input	NAC Control Function	
NAC 1	Strobe Control	All NAC outputs (1 - 8)
NAC 2	Horn Control	

SmartSync Notification Appliance Control

The **TrueAlert Notification Appliance** product line includes addressable and non-addressable operation. Non-addressable models are available with 2-wire SmartSync operation or conventional 4-wire operation. The following details apply to use with the 4009 IDNet NAC Extender:

- TrueAlert non-addressable models with SmartSync operation allow audible notification to be separately controlled over the same wire pair that controls visible notification.
- You can select 4009 IDNet NAC Extenders to provide SmartSync operation whether controlled by IDNet communications or conventional NACs.
- Use IDNet control to individually select output NACs for conventional or SmartSync operation.
- With NAC input control, all output NACs are selected for either conventional or SmartSync operation.
- Refer to data sheet **A009-0003** for TrueAlert Addressable operation details, contact your local Autocall product supplier for further information on specific TrueAlert notification appliances.

Hardwire control NAC connection one-line reference diagram

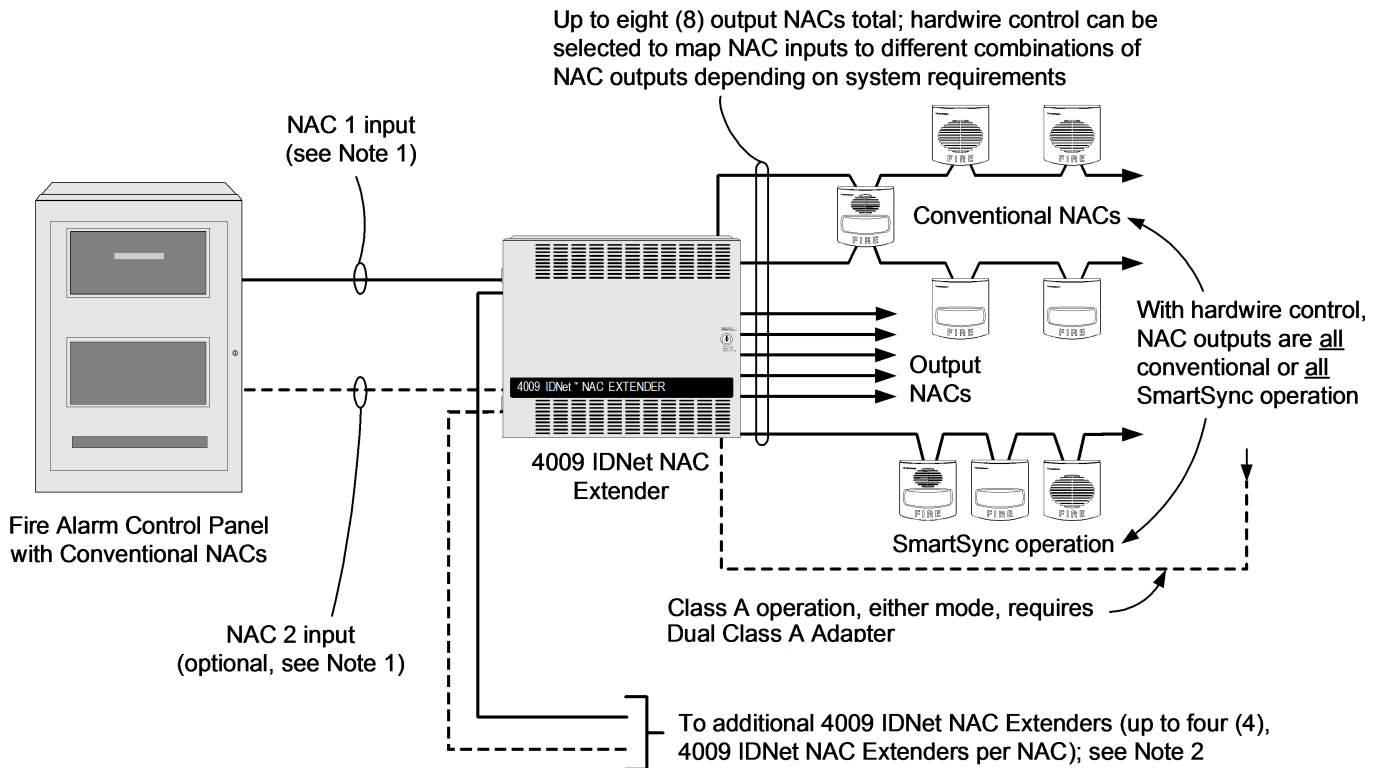


Figure 4: Hardwire control NAC connection one-line reference diagram

Note:

1. For separate audible and visible output NAC control, or SmartSync NAC output operation, 2 input NACs are required. NAC 1 is "on-until-reset" and NAC 2 is "on-until-silenced".
2. To synchronize strobe flash outputs for up to 4 4009 IDNet NAC Extenders, use the synchronized strobe output from a Synchronized Flash Module, or from a NAC selected to provide synchronized strobe flash output. Use A4905-9914 for Class B operation, A4905-9922 for Class A operation.

Note: Do not use a NAC selected for SmartSync operation for this function.

Refer to Installation Instructions **574-181AC** for additional information and application guidance.

4009 IDNet NAC Extender specifications
Table 7: Input ratings

Specification	Rating
120 VAC input (A009-9201)	3A @ 102 VAC -132 VAC, 60 Hz
240 VAC input (A009-9301)	1.5A @ 204 VAC -264 VAC, 50 Hz /60 Hz
Hardwire control from external NACs, input requirements	Conventional reverse polarity operation 5 mA maximum; 16 VDC to 33 VDC

Table 8: Output ratings

Specification	Rating
Total rating	8 A, Special application appliances 6 A, regulated 24 DC appliance power
Standard NACs	2 A each, special application or regulated 24 DC appliance power
Optional NACs (requires A009-9807)	1.5 A each, Special Application appliances 1 A each, Regulated 24 DC appliance power
Special application appliances	Autocall non-addressable horns, strobes, and combination horn/strobes and speaker/strobes (contact your Autocall product representative for compatible appliances)
Regulated 24 DC appliances	Power for other UL listed appliances; use associated external synchronization modules where required
Strobe operation	Up to 33 strobes for each NAC can be synchronized; output NACs configured for Autocall synchronized strobe operation are synchronized to each other
Auxiliary output	500 mA @ 24 VDC nominal

Table 9: Optional modules ratings

Specification	Rating	
IDNet Repeater Module (A009-9809)	Input power	70 mA @ 24 VDC, system supplied
	IDNet input, one address	Maximum distance from IDNet source is 2,500 ft (762 m)
	IDNet output specifications	Repeated IDNet output for up to 100 devices (total IDNet devices not to exceed 250 for each channel)
		Maximum distance to farthest device is 2,500 ft (762 m)
	Total distance including T-taps is 10,000 ft (3048 m)	
	Class A loop maximum distance is 2,500 ft (762 m), no T-taps	

Table 10: Fiber optic receiver modules

Specification	Rating
Input current	A009-9810, Class B, 65 mA @ 24 VDC, system supplied A009-9811, Class X, 80 mA @ 24 VDC, system supplied
IDNet output specifications	Same as those for repeater module
Fiber optic transmission distance	3000 ft (914 m) maximum

Table 11: General specifications

Specification	Rating
Operating temperature	32° F to 120° F (0° C to 49° C)
Operating humidity range	10% to 90% RH from 32° F to 104° F (0° C to 40° C)
Wiring Connections*	Terminal blocks for 18 AWG (stranded) to 12 AWG (solid)
Note: * Metric wire equivalents: 18 AWG = 0.82 mm ² ; 12 AWG = 3.31 mm ²	

Fiber optic transmitter specifications

Table 12: Fiber optic transmitter specifications

Specification	Rating
Input voltage	18.9 VDC -32 VDC from compatible listed fire alarm supply
Input current	A4090-9105, Class B, 30 mA @ 24 VDC
	A4090-9107, Class X, 35 mA @ 24 VDC
Fiber optic connections and cable requirements	Multimode, graded index, 50/125µm, 62.5/125 µm, 100/40 µm, or 200 µm
	Type ST connectors
	A4090-9105, Class B operation, two fiber cables required A4090-9107, Class X operation, four fiber cables required
Module size (with mounting bracket)	6-13/16 in. W x 3-3/4 in. H x 1-1/8 in. D (173 mm x 95 mm x 29 mm)
On-board status indicators	Green LED flashing = transmit
	Red LED flashing = receive
	Separate red LED on A4090-9107 = Class X receive
Communications	Autocall IDNet
Fiber optic transmission distance	3000 ft (914 m) maximum
Wiring connections*	Terminal blocks for 18 AWG (stranded) to 12 AWG (solid)
Operating humidity	10% to 90% RH from 32° F to 104° F (0° C to 40° C)
Operating temperature	32° F to 120° F (0° C to 49° C)
* Metric wire equivalents: 18 AWG = 0.82 mm ² ; 12 AWG = 3.31 mm ²	

4009 IDNet NAC Extender mounting and module placement information

Additional four point module shown SKU A009-9807.

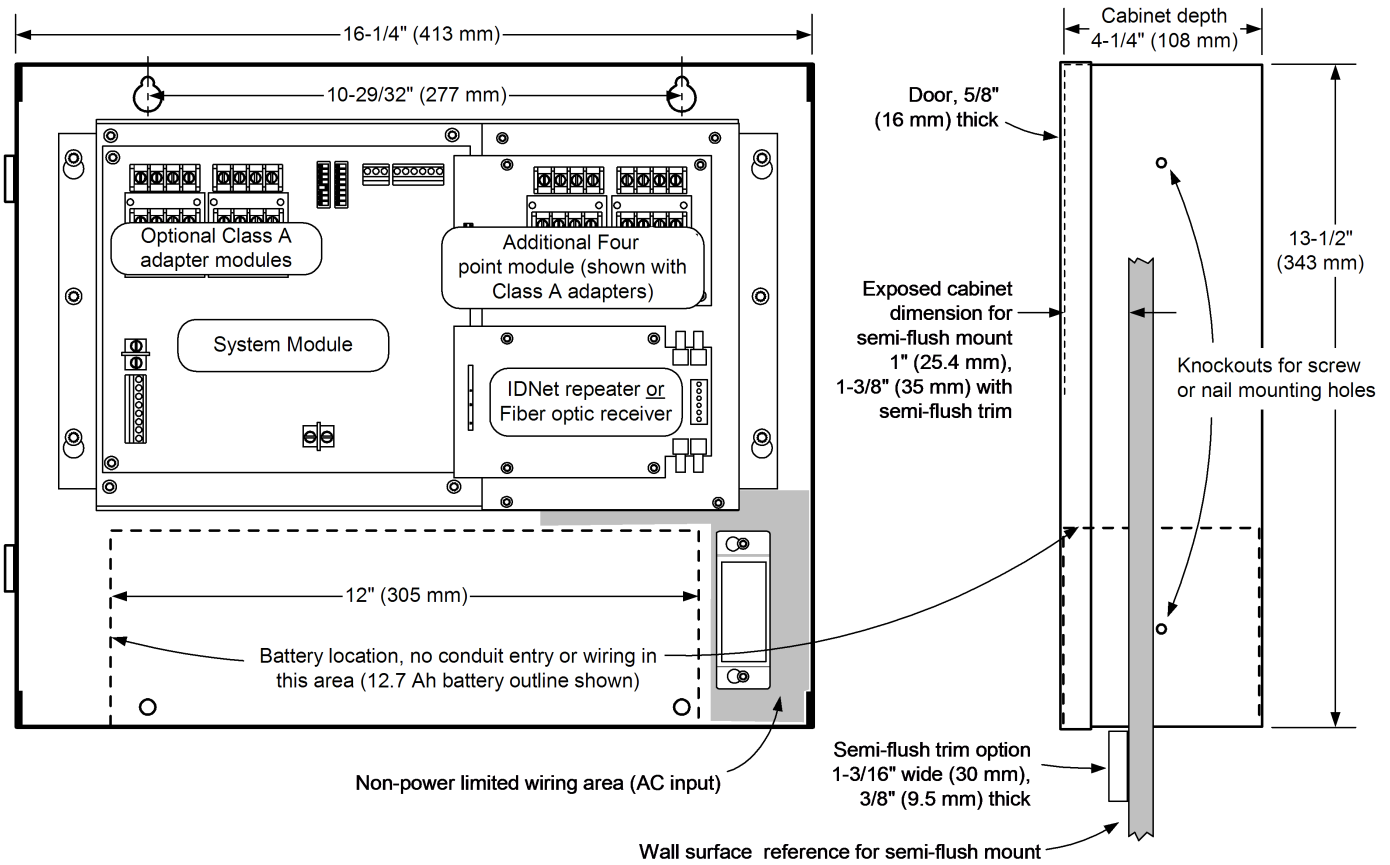


Figure 5: 4009 IDNet NAC Extender mounting and module placement information

Note: Recommended conduit entrance varies with module selection. Refer to general installation instructions 574-181, specific module installation instructions, and to field wiring diagrams 842-068 before locating conduit entrance.

4009 IDNet NAC Extender cabinet with door detail


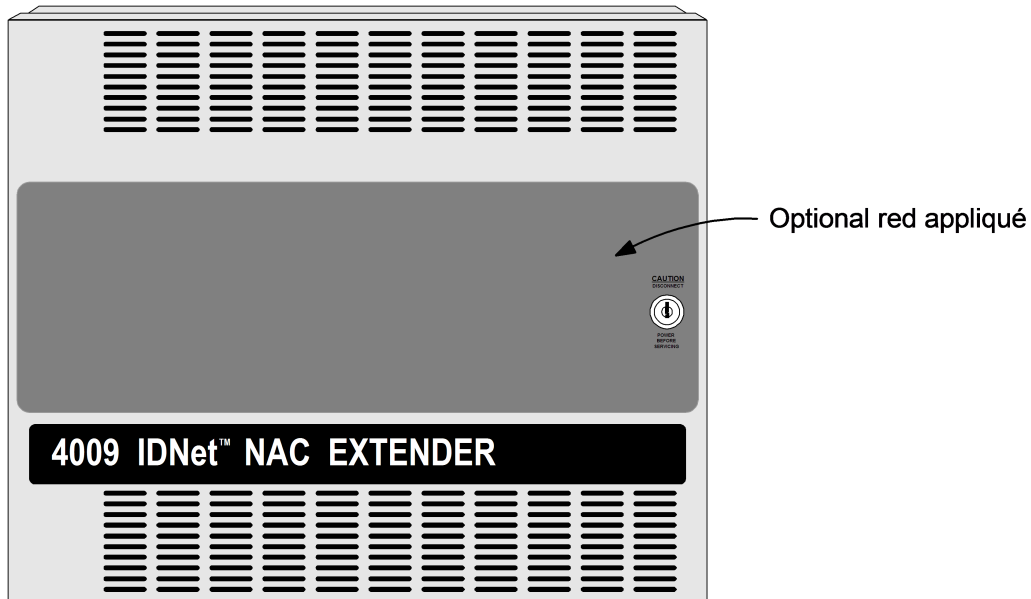


Figure 6: 4009 IDNet NAC extender cabinet with door detail

A4090-9105/9107 IDNet fiber optic transmitter mounting information

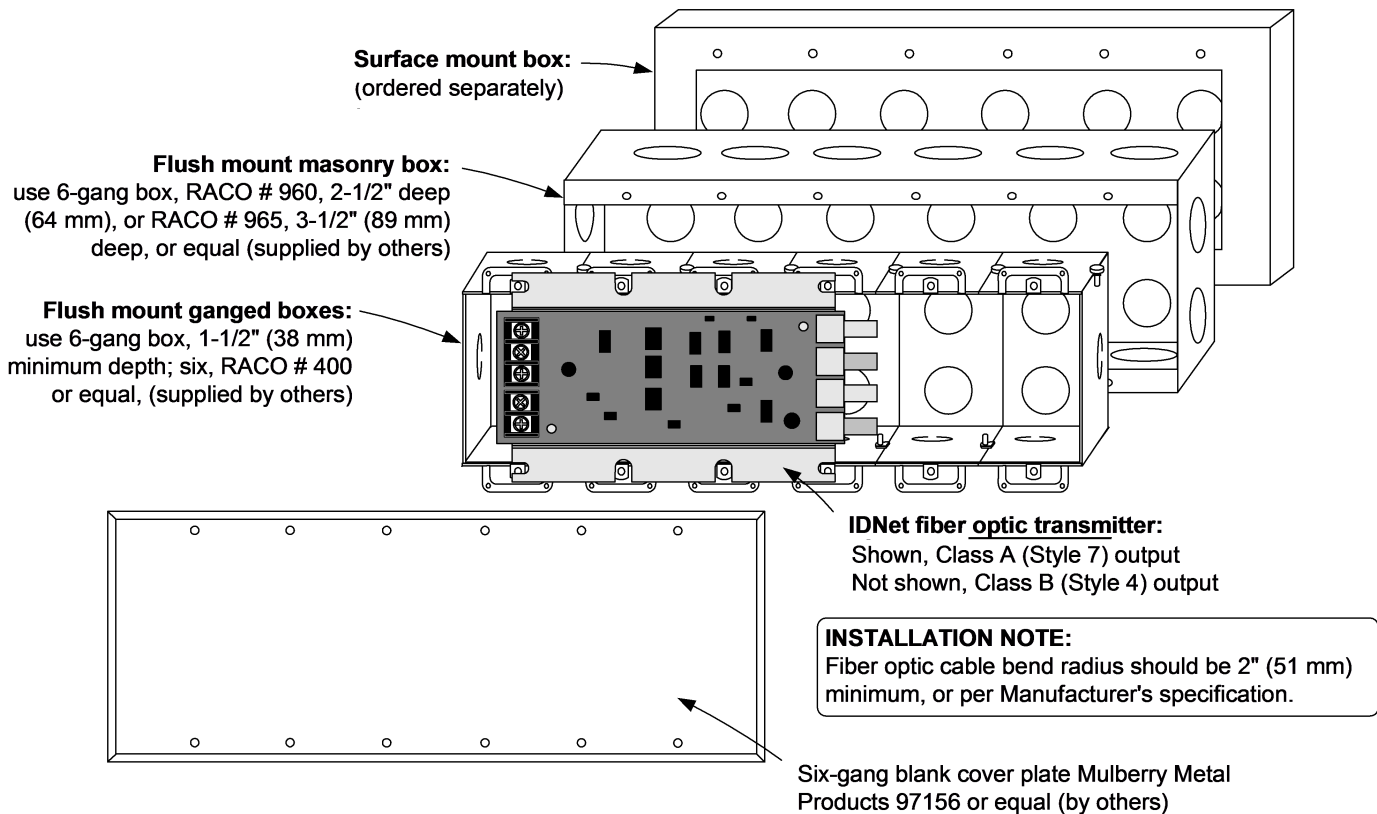

Service diagnostic features

Power-up self-diagnostics. When powering up, the 4009 IDNet NAC Extender tests each module and performs earth fault diagnostics. Trouble conditions are communicated to the host control panel and are also displayed on diagnostic status LEDs in the 4009 IDNet NAC Extender. When connected via IDNet communications, detailed status information is available at the host. When controlled with conventional NAC inputs, common troubles are signaled by providing a polarized open circuit that disconnects the NAC wiring from its end-of-line resistor but still allows a reversed polarity alarm to be received.

Door mounted reference label. The 4009 IDNet NAC Extender has a detailed programming and diagnostic label inside the front door that provides a quick reference for both installation and checkout.

LED Status Indicators are provided for the following:

- **Each NAC** (standard and optional) has a dedicated yellow LED with the following functions:
 - Provides a slow flash during supervision to indicate a short circuit condition and a fast flash to indicate an open circuit.
 - Lights to follow the NAC output during an alarm, on steady or flashing with coded output.
- **Four, general status yellow LEDs** provide nine separate indications listed in priority of urgency. As a trouble is eliminated, any remaining trouble will then be indicated until the 4009 IDNet NAC Extender is returned to normal operation.
- **AC power status** is indicated by a green LED that is on when AC is normal. During low AC (brownout) conditions or with no AC, the LED is off. Additional power and battery status is indicated by the general status LEDs.

4009 IDNet NAC Extender current calculation chart

Use the following steps to calculate IDNet NAC Extender current:

1. Calculate the basic extender battery requirements, minus NAC loads. Use Table 13.
2. Calculate IDNet output module and device current if used. Use Table 14.
3. Calculate actual NAC loading, limited to available NAC current. Use Table 15.
4. Calculate total supervisory current. Use Table 16.
5. Calculate total alarm current. Use Table 17.

Table 13: Panel, NAC Options, and Auxiliary Power:

Model	Description	Supervisory current	Actual supervisory	Alarm current	Actual alarm
A009-9201	120 VAC input	85 mA	85 mA	185 mA	185 mA
A009-9301	240 VAC input				
A009-9807	Additional four point NAC	40 mA	+ _____	40 mA	+ _____
A009-9808	Dual class A adapter (no additional current)	-	-	-	-
Auxiliary power output		(500 mA maximum)	+ _____	(500 mA maximum)	+ [A1] _____
Basic panel supervisory current			= [S1] _____		
Basic panel alarm current					= [A2] _____

Table 14: IDNet output module and device current:

Model	Description	Supervisory current	Actual supervisory	Alarm current	Actual alarm
A009-9809	IDNet Repeater	70 mA	+ _____	70 mA	+ _____
A009-9810*	Fiber Optic Receiver, Class B	65 mA		65 mA	
A009-9811*	Fiber Optic Receiver, Class X	80 mA		80 mA	
IDNet devices (connected to repeater or receiver above), 0.7 mA each, maximum of 100		Total devices x 0.7 mA each	+ _____	Total devices x 0.7 mA each	+ _____
Note: IDNet Fiber Optic Transmitter current is supplied from the host fire alarm control panel		IDNet module supervisory current	[S2] = _____		
		IDNet module alarm current			= [A3] _____
Calculate available NAC current.			Maximum available current		= 8 A*
			Subtract auxiliary power output		- [A1] _____
			Subtract IDNet module current		- [A3] _____
* 8 A for special application appliances; 6 A for regulated 24 DC appliances			Available NAC current		= [A4] _____

Table 15: Actual NAC loading, limited to available NAC current:

NAC type	NAC circuit #	NAC alarm current
Standard panel NACS , 2 A maximum for each NAC	Circuit 1	+ _____
	Circuit 2	+ _____
	Circuit 3	+ _____
	Circuit 4	+ _____
Optional four point NAC module , 1.5 A maximum special application rating, 1 A maximum regulated 24 DC rating, per NAC	Circuit 5	+ _____
	Circuit 6	+ _____
	Circuit 7	+ _____
	Circuit 8	+ _____
Total actual NAC load alarm current		= [A5] _____

Table 16: Total supervisory current:

Description	Total supervisory current
Total supervisory current = Basic panel current [S1] + IDNet Module current [S2] =	_____

Table 17: Total alarm current:

Description	Total alarm current
Total alarm current = Basic panel current [A2] + IDNet module current [A3] + actual NAC Current [A5] =	_____